SHEET KEYNOTES

1. EXISTING 10" TS AND 10" BS CONTRACTOR TO FIELD VERIFY LOCATION. CONTRACTOR TO PROTECT SUCTION PIPE DURING REHABILITATION.
2. CONTRACTOR TO INSPECT EXISTING 10" BS AND 10" TS PENETRATION ONCE TANK IS CLEANED FOR LEAKS AND COOROSION. REPLACE PER DETAILS 3353 AND 2205-110 AS DIRECTED BY ENGINEER. CONNECT TO EXISTING PIPE WITH FCA. REFER TO UNIT PRICE BID ITEMS 1 AND 2.

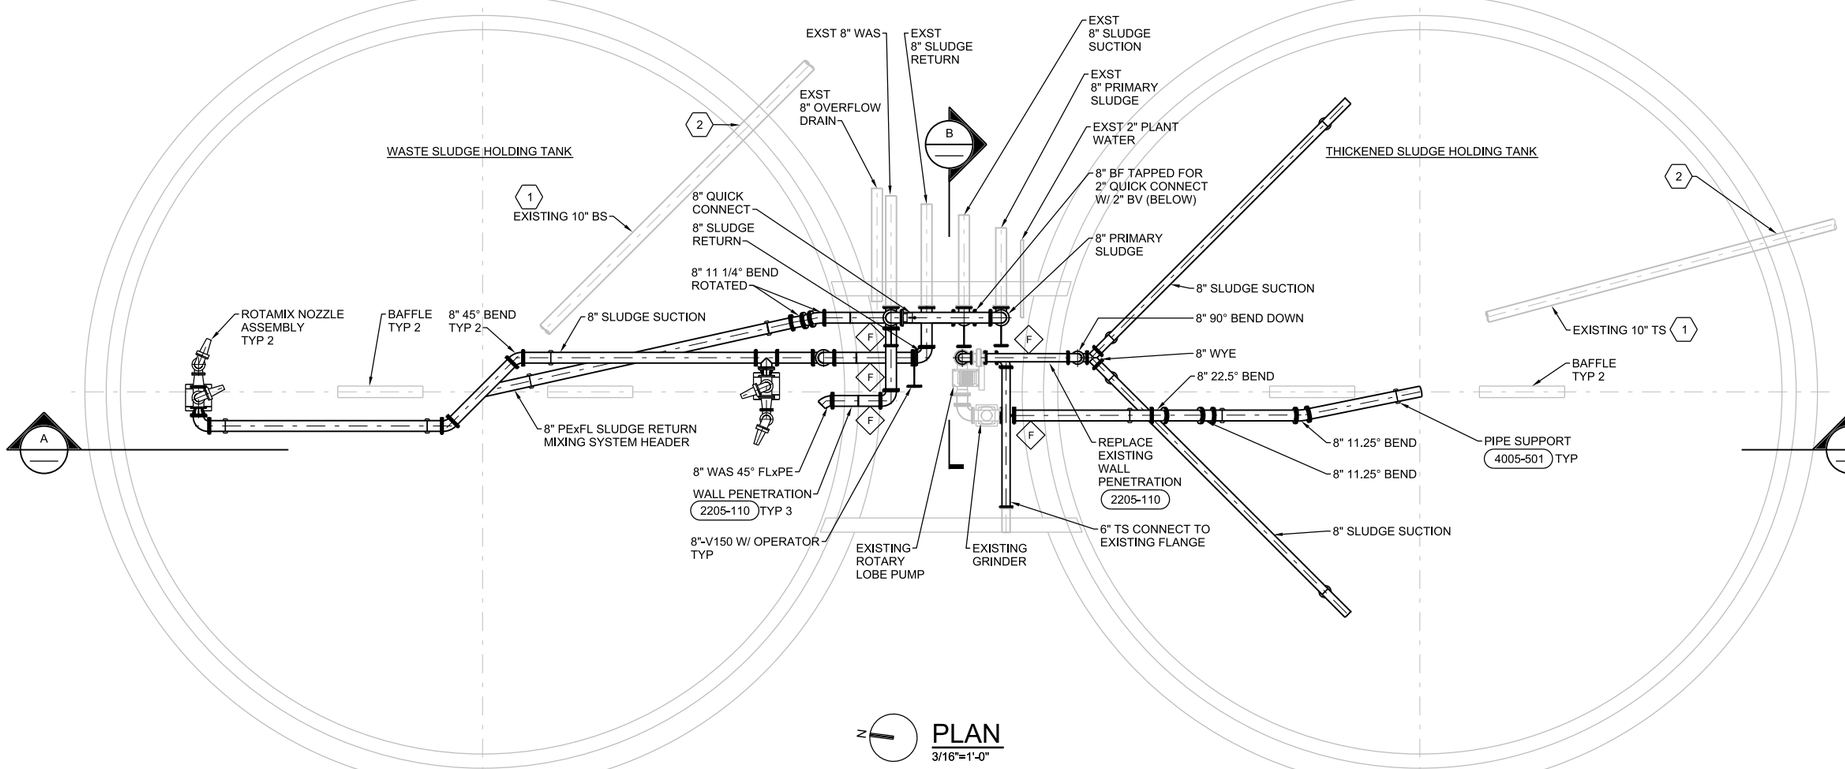

PLAN
3/16"=1'-0"

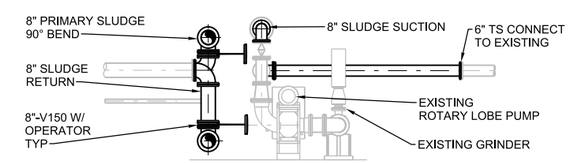

B SECTION
1/4"=1'-0"

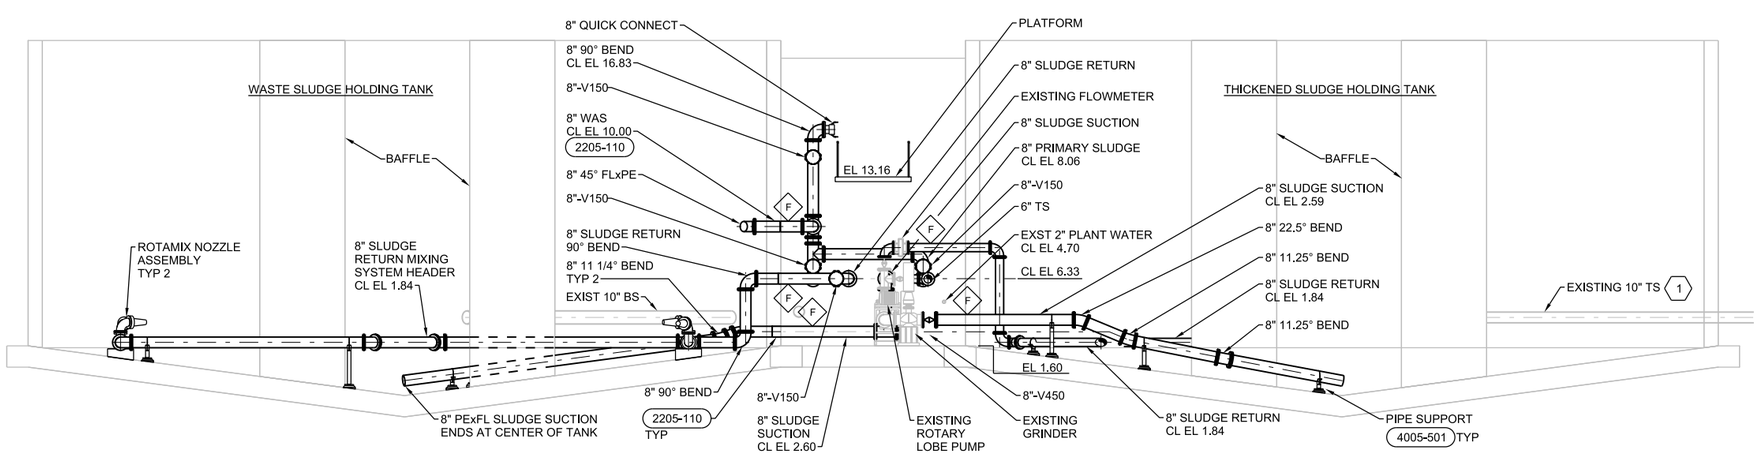

A SECTION
3/16"=1'-0"

NO.	DATE	REVISION	BY	APVD

DSGN S CLARK | DR N PATTERSON | CHK S CLARK | APVD S CLARK

SLUDGE STORAGE TANKS REHABILITATION
NEW LONDON, CONNECTICUT
WASTE WATER TREATMENT PLANT
NEW LONDON, CONNECTICUT

PROCESS MECHANICAL
SLUDGE HOLDING TANKS
PLAN AND SECTION

REUSE OF DOCUMENTS: THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE IS THE PROPERTY OF CH2M HILL AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF CH2M HILL.
©CH2M HILL 2015. ALL RIGHTS RESERVED.

STEPHEN A. CLARK
STATE OF CONNECTICUT
LICENSED PROFESSIONAL ENGINEER
No. 29849

VERIFY SCALE
BAR IS ONE INCH ON ORIGINAL DRAWING.
0 1"

DATE	NOVEMBER 2016
PROJ	668991
DWG	D-001
SHEET	of

BID DOCUMENTS

FILENAME: 220-D-001_668991.dgn PLOT DATE: 11/27/2016 PLOT TIME: 7:03:03 PM